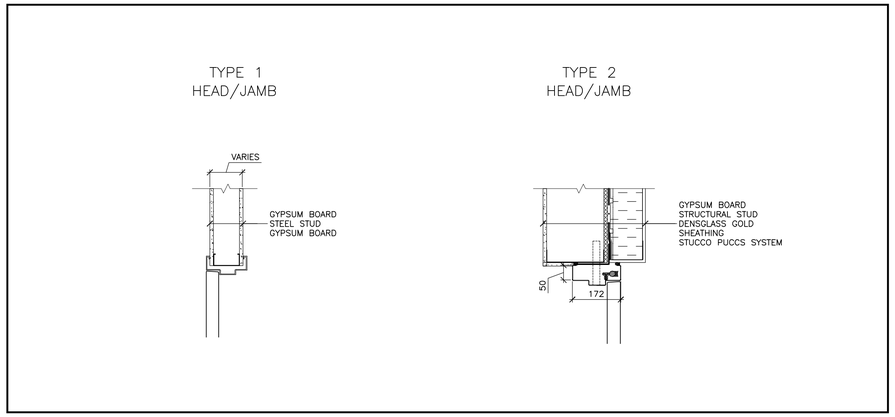

4 DOOR FRAME TYPES
1:10

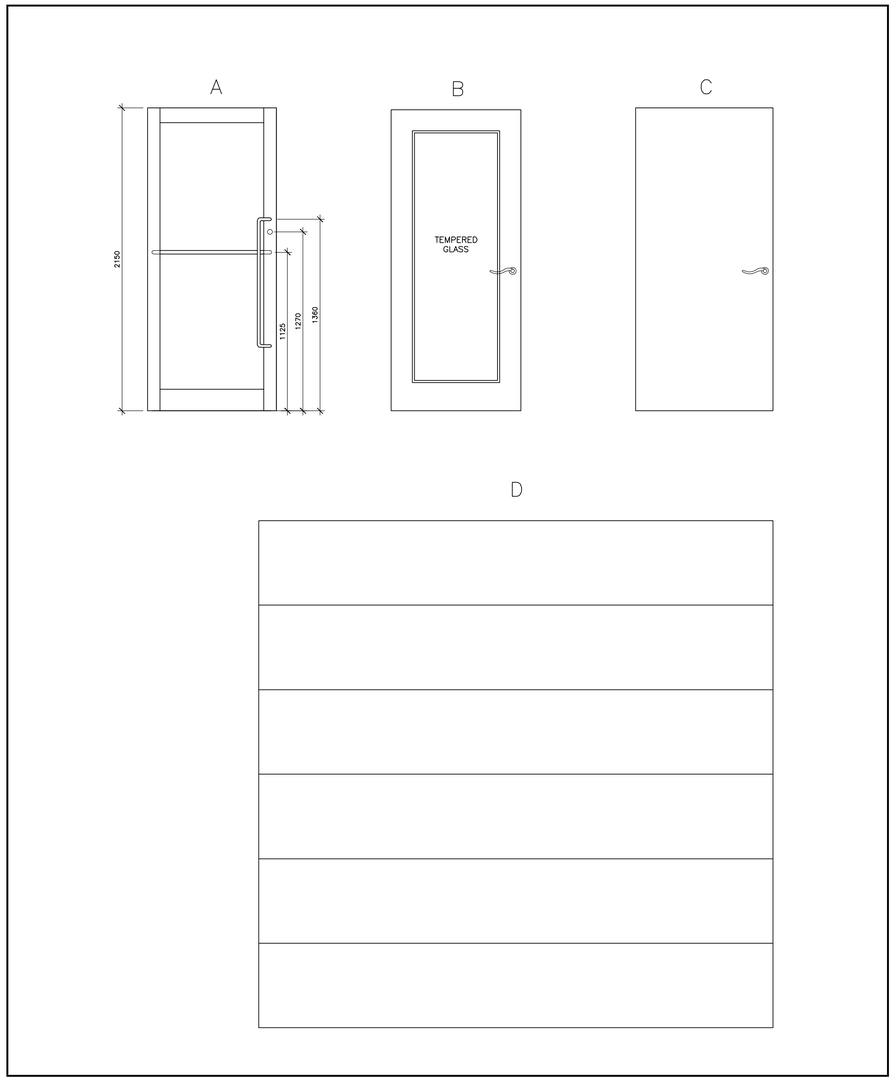

3 DOOR TYPES
1:20

ROOM FINISH SCHEDULE

ROOM NO.	ROOM NAME	FLOOR MAT'L	FLOOR FIN.	BASE MAT'L	BASE HGT.	WALLS MAT'L	WALLS FIN.	CEILING MAT'L	CEILING FIN.	CEILING HGT.	REMARKS
101	VESTIBULE	CONC.	PT1	PT1	150	GB	PAINT 1	A.T.	–	2700	
102	RECEPTION	CONC.	CP	CP	150	GB	PAINT 1	A.T.	–	2700	
103	OFFICE	CONC.	CP	CP	150	GB	PAINT 1	A.T.	–	2700	
104	WASHROOM	CONC.	PT1	PT1	150	GB	PAINT 1	A.T.	–	2700	
105	WAREHOUSE	CONC.	SEALER	–	–	GB	PAINT 1	DECK	–	±6000	
201	VESTIBULE	CONC.	PT1	PT1	150	GB	PAINT 1	A.T.	–	2700	
202	RECEPTION	CONC.	CP	CP	150	GB	PAINT 1	A.T.	–	2700	
203	OFFICE	CONC.	CP	CP	150	GB	PAINT 1	A.T.	–	2700	
204	WASHROOM	CONC.	PT1	PT1	150	GB	PAINT 1	A.T.	–	2700	
205	WAREHOUSE	CONC.	SEALER	–	–	GB	PAINT 1	DECK	–	±6000	
301	SPRINKLER ROOM	CONC.	SEALER	–	–	GB	PAINT 1	DECK	–	±6000	
401	ELECTRICAL ROOM	CONC.	SEALER	–	–	GB	PAINT 1	DECK	–	±6000	

LEGEND:

AT	ACOUTIC TILE (TO BE DETERMINED)
CP	CARPET (TO BE DETERMINED)
GB	GYPSUM BOARD
PAINT 1	TO BE DETERMINED
PT1	PORCELAIN TILE (TO BE DETERMINED)

NOTES:

1. LEVEL FLOOR WITH LATEX FILLER PRIOR TO FLOOR FINISH.

2 ROOM FINISH SCHEDULE
NTS

DOOR AND FRAME SCHEDULE

DOOR NO.		DOOR SIZE WIDTH	HGT.	THICK.	TYPE	MAT'L	CORE	GLAZING	FRAME MAT'L	CORE	TYPE	F.R.R.	CLOSER	REMARKS
101	VESTIBULE 101	950	2150	45	A	ALU	INSUL	TEMPERED	ALU	–	–	–	●	THERMAL BREAK SECTIONS, WIDE STILE
102	RECEPTION 102	950	2150	45	B	HM	–	TEMPERED	HM	–	1	–		
103	OFFICE 103	950	2150	45	B	HM	–	TEMPERED	HM	–	1	–		
104	WASHROOM 104	950	2150	45	C	HM	INSUL	–	HM	–	1	–		GYPSUM CORE
105	WAREHOUSE 105	950	2150	45	C	HM	INSUL	–	HM	–	1	–	●	WEATHERSTRIPS (ACOUSTIC) GYPSUM CORE
106	WAREHOUSE 105	950	2150	45	C	HM	INSUL	–	HM	–	2	–	●	THERMAL BREAK FRAME
107	WAREHOUSE 105	3600	3600	45	D	HM	INSUL	–	HM	–	–	–		OVERHEAD DOOR, U–VALUE 2.27 MAX.
201	VESTIBULE 201	950	2150	45	A	ALU	INSUL	TEMPERED	ALU	–	–	–	●	THERMAL BREAK SECTIONS, WIDE STILE
202	RECEPTION 202	950	2150	45	B	HM	–	TEMPERED	HM	–	1	–		
203	OFFICE 203	950	2150	45	B	HM	–	TEMPERED	HM	–	1	–		
204	WASHROOM 204	950	2150	45	C	HM	INSUL	–	HM	–	1	–		GYPSUM CORE
205	WAREHOUSE 205	950	2150	45	C	HM	INSUL	–	HM	–	1	–	●	WEATHERSTRIPS (ACOUSTIC) GYPSUM CORE
206	WAREHOUSE 205	950	2150	45	C	HM	INSUL	–	HM	–	2	–	●	THERMAL BREAK FRAME
207	WAREHOUSE 205	3600	3600	45	D	HM	INSUL	–	HM	–	–	–		OVERHEAD DOOR, U–VALUE 2.27 MAX.
301	SPRINKLER ROOM 301	950	2150	45	C	HM	INSUL	–	HM	–	2	–	●	THERMAL BREAK FRAME
401	ELECTRICAL ROOM 401	950	2150	45	C	HM	INSUL	–	HM	–	2	–	●	THERMAL BREAK FRAME

LEGEND:

ALU	ALUMINUM
FRR	FIRE RESISTANCE RATING
FG	FIREGLASS
HC	HONEYCOMB
HM	HOLLOW METAL
INSUL	INSULATED
SC	SOLID CORE

NOTES:

1. ALL CLOSERS TO COMPLY WITH OBC 2012 BARRIER FREE REQUIREMENTS.
2. DOOR HANDLE – LEVER UNLESS NOTED OTHERWISE.
3. DOOR TO HAVE U–VALUE 2.27 MAXIMUM.
4. EXTERIOR DOORS TO HAVE THERMAL BREAK FRAME.

1 DOOR & FRAME SCHEDULE
NTS

The contractor shall check all dimensions and other data from the job and report any discrepancies to the architects before proceeding. Do not scale drawing.

NO.	REVISIONS	DATE
1	ISSUED FOR BUILDING PERMIT	2015-08-05

Owner
JOCHRI INVESTMENTS LIMITED

Drawing Title
SCHEDULES

Project Title
NEW WAREHOUSE

200 INDUSTRIAL PARKWAY SOUTH AURORA

ONTARIO ASSOCIATION OF ARCHITECTS
DONALD J. CAUNTER
LICENCE
3155

Donald J. Caunter
Architect Limited
40 St. Clair Ave. East, Suite 302, Toronto, ON M4T 1M9 (416) 922-2040

Approved	Checked	Drawn By
DC	DC	WT
Scale: AS NOTED	Date: 2014-09-10	File No.: 116902

Drawing Number: A-601
Revision Number:

Computer File Number: 116902-A-601

Copyright 2014